

## SERIES SR60

- Initial setting are easily done on the display (PV and SV display) through the keyboard.
- Accuracy  $\pm(1/3\% \text{ FS} + 1 \text{ digit})$
- Sampling cycle: 0.25 sec.
- The PID control performance is greatly improved through a new processing method (expert PID) and the Auto Tuning point can be set as desired.
- A setting limit, output limit, PV bias, PV filter, manual control, and output characteristic selection function are provided as standard functions.
- A wide selection of additional functions (optional) is available to suit various needs.



**CE** & **CSA®** NRTL/IC approved

**SPECIFICATIONS****Display**

Digital display:	7 segment / Measured value (PV) Red LED 4 digits, Set value (SV) Green LED 4 digits
Display accuracy:	$\pm(1/3\% \text{ FS} + 1 \text{ digit})$ at $23\pm 5^\circ\text{C}$ Refer to Table of Measuring Range Codes.
Display resolution:	Depends on measuring range (0.001, 0.01, 0.1, 1)
Sampling cycle:	0.25 sec.
Action display / colors:	7-type LED lamp indication: Control output (OUT) / Green, Higher limit alarm (AH) / Red, Lower limit alarm (AL) / Red, Event / Heater break alarm (EV / HB) / Red, Auto tuning (AT) / Green, Manual control (MAN) / Red, Set value bias (SB) / Green

**Setting**

Setting:	By 6 front key switches
Setting range:	Same as measuring range
Setting limit:	Higher / lower limits individual setting as desired within measuring range (lower limit value < higher limit value)

**Input**

Thermocouple:	B, R, S, K, E, J, T, N, PL II, WRe5-26, {U, L (DIN 43710)} (Multi-input, multi-range: Refer to Table of Measuring Range Codes.)
External resistance:	100Ω max.
Input impedance:	500kΩ min.
Burnout:	Standard feature (up scale)
Cold junction temperature compensation accuracy:	$\pm 2^\circ\text{C}$ ( $5\sim 45^\circ\text{C}$ )
R.T.D.:	JIS Pt100 / JPt100 3-wire type (Multi range: Refer to Table of Measuring Range Codes.)
Amperage:	Approx. 0.25mA
Lead wire tolerable resistance:	5Ω max. / wire
Voltage:	-10~10, 0~10, 0~20, 0~50, 10~50, 0~100mV DC or -1~1, 0~1, 0~2, 0~5, 1~5, 0~10V DC (Multi input, programmable range: Refer to Table of Measuring Range Codes.)
Input impedance:	500kΩ min.
Current:	4~20, 0~20mA DC (Multi input, programmable range: Refer to Table of Measuring Range Codes.)

Receiving impedance:	250Ω
Sampling cycle:	0.25 sec.
PV bias:	-1999~1999 unit
PV filter:	0~100 sec.
Isolation:	Insulated between input and output (not insulated between input and system, SV bias and CT input)

**Control**

Control mode:	Auto-tuning PID
Proportional band ( P ):	Off, 0.1~999.9% FS (Off setting: On-Off action)
Integral time ( I ):	Off, 1~6000 sec. (Off setting: PD, P action)
Derivative time ( D ):	Off, 0~3600 sec. (Off setting: PI, P action)
Manual reset ( MR ):	-50.0~50.0% (Valid when I=Off.)
On-Off hysteresis:	1~999 unit
Proportional cycle:	1~120 sec.
Control output characteristics:	RA / DA selectable (set to RA when shipped)
Higher and lower output limit:	0.0~100.0% (lower limit < higher limit)

**Control output type / rating**

Contact output ( Y1 ):	240V AC 2.5A / resistive load
Current output ( I1 ):	4~20mA DC / load resistance: 600Ω max.
SSR drive voltage output ( P1 ):	15±3V DC / load current: 20mA max.
Voltage output ( V1 ):	0~10V DC / load current: 2mA max.
Isolation:	Insulated between control output and system and input (not insulated between control output I, P, V and analog output)

**Manual control**

Output setting range:	0.0~100.0% (setting resolution: 0.1%)
Output resolution:	Within range of higher / lower output limits
Auto / Manual switching:	0.5%

**Additional Functions (Optional)****Alarm output**

Alarm method:	Individual setting and individual output, higher and lower limit alarms
Alarm type:	Deviation value alarm or absolute value alarm is selectable.
Alarm setting range:	Deviation value: Higher limit: 0~5000 unit Lower limit: -1999~0 unit  When alarm is set beyond higher or lower limit of measuring range, alarm is activated at a point 10% beyond higher or lower limit.
Alarm action:	Absolute value: Higher and lower limits: Within measuring range
Action hysteresis:	On~Off action
Inhibit mode:	1~999 unit (both higher and lower limits)
Alarm output / rating:	Selectable (both higher and lower limits) Contact 1a (common) / 240V AC 1.5A (resistive load)

**Event output (Cannot be selected when heater break alarm is selected.)**

Number of event outputs:	1 point
Event type:	Selectable from following 8 types
	1. Higher limit deviation value alarm without inhibit mode 2. Lower limit deviation value alarm without inhibit mode 3. Higher limit absolute value alarm without inhibit mode 4. Lower limit absolute value alarm without inhibit mode 5. Higher limit deviation value alarm with inhibit mode 6. Lower limit deviation value alarm with inhibit mode 7. Higher limit absolute value alarm with inhibit mode 8. Lower limit absolute value alarm with inhibit mode
Setting range:	Deviation value: Higher limit: 0~5000 unit Lower limit: -1999~0 unit  When alarm is set beyond higher or lower limit of measuring range, alarm is activated at a point 10% beyond higher or lower limit.
	Absolute value: Within measuring range of higher and lower limits

# DIGITAL CONTROLLER

Event action:	On-Off action
Event action hysteresis:	1~999 unit
Event output / rating:	Contact 1a / 240V AC 1.5A (resistive load)

## Heater break alarm (Cannot be selected when event output is selected.)

Alarm action:	Heater amperage detected by externally attached CT (CT provided) Alarm output On upon detection of heater break while output is On. Alarm output On upon detection of heater loop alarm while output is Off.
Current setting range:	Off, 0.1~50.0A (Alarm action stops when Off is set.)
Setting resolution:	0.1A
Amperage display:	0.0~55.0A
Display accuracy:	3% FS (when sine wave is 50Hz)
Minimum time for action confirmation:	On time: 250 msec. minimum
Alarm output / rating:	Contact 1a / 240V AC 1.5A (resistive load)
Alarm holding:	Selectable
Sampling cycle:	0.5 sec.
Isolation:	Insulated between CT input and output (not insulated between CT input and system and other inputs)

## Analog output

Number of analog outputs:	1 point
Analog output type:	Selectable between process value (PV) and set value (SV)
Analog output:	0~10mV DC, output resistance: 10Ω 0~10V DC, Load current: 2mA max. 4~20mA DC, Load resistance: 300Ω max.
Output accuracy:	±0.3% (of displayed value)
Output resolution:	Approx. 0.0125% (1 / 8000)
Output updating cycle:	0.25 sec.
Output scaling:	Within measuring range
Isolation:	Insulated between analog output and system and input (not insulated between analog output and control output I, P, V)

## Set value bias

Setting range:	-1999~5000 unit
Setting resolution:	Same as display resolution
Action input:	Non-voltage contact (bias in action when input is closed)
Isolation:	Insulated between set value bias input and output (not insulated between set value bias input and system and other inputs)

## Others

Data storage:	By non-volatile memory (EEPROM)
Operating ambient temperature / humidity range:	-10~50°C / 90% RH maximum (no dew condensation)
Supply voltage:	100~240V AC±10% (50 / 60Hz), 24V AC±10% (50 / 60Hz) or 24V DC±10%
Power consumption:	SR62, SR63, SR64: Max. 8VA (AC), 8W (DC)
Applicable standard:	Safety: IEC1010-1 EMC EMI (emission): EN50081-1 EMS (immunity): EN50082-2
Insulation resistance:	Between input / output terminal and power supply terminal: 500V DC 20MΩ minimum Between input / output terminal and ground terminal: 500V DC 20MΩ minimum
Dielectric strength:	1 min. at 1000V AC between input / output terminal and power supply terminals 1 min. at 1500V AC between power supply terminal and ground terminals
Protective structure:	Only front panel has simple dust-proof and drip-proof structure.
Material:	PPO resin molding (equivalent to UL94V-1)
External dimensions:	SR62: H72 × W72 × D110 (Panel depth: 100) mm SR63: H96 × W96 × D 70 (Panel depth: 60) mm SR64: H96 × W48 × D110 (Panel depth: 100) mm
Mounting:	Push-in panel (one-touch mount)
Panel thickness:	1~3.5mm
Panel cutout:	SR62: 68 × 68mm SR63: 92 × 92mm SR64: 92 × 45mm
Weight:	SR62: Approx. 290g SR63: Approx. 310g SR64: Approx. 280g

## ORDERING INFORMATION

ITEMS	CODE		SPECIFICATIONS
SERIES	SR62-		
	SR63-		
	SR64-		
INPUT	1		
	2		
	3		
	4		
	6		
CONTROL OUTPUT	Y1-		
	I1-		
	P1-		
	V1-		
POWER SUPPLY	90-		
	10-		
	02-		
ALARM, EVENT, HEATER BREAK ALARM  Note: Heater break alarm can be selected when control output Y1 and / or P1 is selected.	00	None	
	03	Higher & lower limit alarms	
	12	Higher & lower limit alarms + event output	
	13	Higher & lower limit alarms + heater break alarm (30A)	
	14	Heater break alarm (30A)	
	15	Higher & lower limit alarms + heater break alarm (50A)	
	16	Heater break alarm (50A)	
ANALOG OUTPUT	0	None	
	3	Voltage 0~10mV DC    Output resistance: 10Ω	
	4	Current 4~20mA DC    Load resistance: 300Ω max.	
	6	Voltage 0~10V DC    Load current: 2mA max.	
SET VALUE BIAS	0	Without	
	1	With	
REMARKS	C	Without (for CE & CSA / NRTL Marking)	
	9	With (for remarks other than CE & CSA / NRTL Marking)	

\* The series is designed for multi-input, multi-range and programmable range operation. If you specify your desired code from the Table of Measuring Range Codes, we will set the product as requested before shipment.

Example: If k 0~1200°C is your operation condition, specify the code "06". (For voltage and current Selection, refer to the Table of Measuring Range Codes.)

\* If no code is specified, the following factory setup is applied.

## SPECIAL CONTROL OUTPUTS AVAILABLE

In addition to the above listed Control Outputs, 0~5V DC and 0~20mA DC are available.

Please use code no. "3" instead of "1".

Coding Example: SR62-1I3-90-00000

(0~20mA DC Output)

SR64-2V3-90-00000

(0~5V DC Output)

INPUT	Standard / Rating	RANGE
1. Thermocouple	JIS K	0~800°C
2. R.T.D.	JIS Pt100	0.0~200.0°C
3. Voltage	0~10mV DC	0.0~100.0 No-legend
4. Current	4~20mA DC	0.0~100.0 No-legend
5. Voltage	1~5V DC	0.0~100.0 No-legend

# DIGITAL CONTROLLER

## MEASURING RANGE CODES

① Type of input		② Measuring range		
Type	Code	°C	Code	°F
Thermocouple	*1 B 01	0 ~ 1800	15	0 ~ 3300
	R 02	0 ~ 1700	16	0 ~ 3100
	S 03	0 ~ 1700	17	0 ~ 3100
	K 04	-100.0 ~ 400.0	18	-150 ~ 750
	K 05	0 ~ 800	19	0 ~ 1500
	K 06	0 ~ 1200	20	0 ~ 2200
	E 07	0 ~ 700	21	0 ~ 1300
	J 08	0 ~ 600	22	0 ~ 1100
	T 09	-199.9 ~ 200.0	23	-300 ~ 400
	*2 N 10	0 ~ 1300	24	0 ~ 2300
	*3 PLII 11	0 ~ 1300	25	0 ~ 2300
	*4 WRe5-26 12	0 ~ 2300	26	0 ~ 4200
	*5 U 13	-199.9 ~ 200.0	27	-300 ~ 400
	*5 L 14	0 ~ 600	28	0 ~ 1100
R.T.D.	Pt100 31	-200 ~ 600	47	-300 ~ 1100
	Pt100 32	-100.0 ~ 100.0	48	-150.0 ~ 200.0
	Pt100 33	-100.0 ~ 300.0	49	-150.0 ~ 600
	Pt100 34	-50.0 ~ 50.0	50	-50.0 ~ 120.0
	Pt100 35	*6 0.0 ~ 50.0	51	0.0 ~ 120.0
	Pt100 36	0.0 ~ 100.0	52	0.0 ~ 200.0
	Pt100 37	0.0 ~ 200.0	53	0.0 ~ 400.0
	Pt100 38	0.0 ~ 500.0	54	0 ~ 1000
	JPt100 39	-200 ~ 600	55	-300 ~ 1100
	JPt100 40	-100.0 ~ 100.0	56	-150.0 ~ 200.0
	JPt100 41	-100.0 ~ 300.0	57	-150.0 ~ 600
	JPt100 42	-50.0 ~ 50.0	58	-50.0 ~ 120.0
	JPt100 43	*6 0.0 ~ 50.0	59	0.0 ~ 120.0
	JPt100 44	0.0 ~ 100.0	60	0.0 ~ 200.0
	JPt100 45	0.0 ~ 200.0	61	0.0 ~ 400.0
	JPt100 46	0.0 ~ 500.0	62	0 ~ 1000
mV	-10~ 10mV 71	The scaling function allows the measuring range to be set as desired within the following limits.  Scaling range: -1999~9999 count Span: 100~5000 counts		
	0~ 10mV 72			
	0~ 20mV 73			
	0~ 50mV 74			
	10~ 50mV 75			
	0~100mV 76			
V	-1~ 1V 81	The factory setup can be adjusted to each user's desired measuring range before shipment. When ordering, specify the input type, measuring range and legend.  Example: [72 0.0-20.0] 26		
	0~ 1V 82			
	0~ 2V 83			
	0~ 5V 84			
	1~ 5V 85			
	0~ 10V 86			
	mA			
mA	0~ 20mA 94	① Input type 0~10mV ② Measuring range user specification ③ Legend kg / cm²		
	4~ 20mA 95			

## LEGEND CODES

③ Legend	Code	④ Legend	Code
Plain (Non)	00	l / min	30
°C	01	l / h	31
°F	02	m³ / min	32
% RH	03	m³ / h	33
%	04	Nm³ / min	34
K	05	Nm³ / h	35
mV	06	mm / s	36
V	07	m / s	37
mA	08	m / min	38
A	09	m / h	39
W	10	m / s²	40
μS / cm	11	rpm	41
mbar	12	mm	42
bar	13	cm	43
psi	14	m	44
psig	15	mm³	45
Pa	16	cm³	46
kPa	17	m³	47
mmH₂O	18	in	48
mH₂O	19	lb	49
inH₂O	20	g	50
mmHg	21	kg	51
cmHg	22	t	52
inHg	23	l	53
l / s	24	ppm	54
kg / h	25	pH	55
kg / cm²	26	cal	56
kgf / cm²	27	kcal	57
Torr	28	Plain	58
mmAq	29		

\* Codes 58 and 59 are to be filled in by the user.

### Note:

\*1. Thermocouple B: 400°C / 750°F or below is out of the accuracy guarantee range.

\*2. Thermocouple N: Nicrosil-Nisil IEC

\*3. Thermocouple PL II: Platinel

\*4. Thermocouple WRe5-26: (Hoskins Mfg. Co.)

\*5. Thermocouple U, L: DIN 43710





- Thermocouple B, R, S, K, E, J, T: JIS / ANSI / IEC

\*6. R.T.D.: Accuracy ±0.3°C (±0.8°F)

- R.T.D.: JPt100: (Old) JIS

**SR62 EXTERNAL DIMENSIONS, PANEL CUTOUT & TERMINAL ARRANGEMENT**





## ° Panel cutout

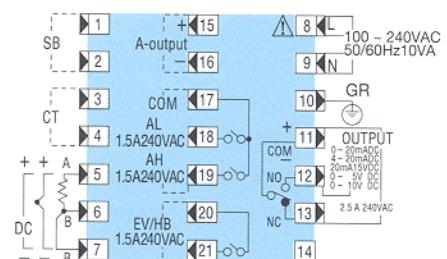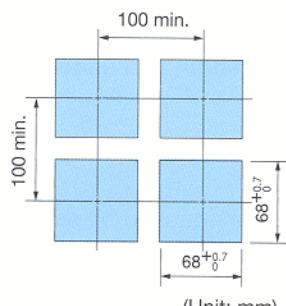



(Unit: mm)

**SR63 EXTERNAL DIMENSIONS, PANEL CUTOUT & TERMINAL ARRANGEMENT**

## ° Panel cutout

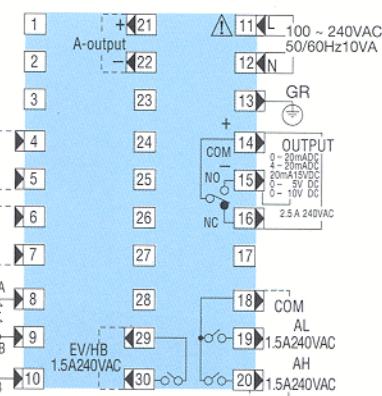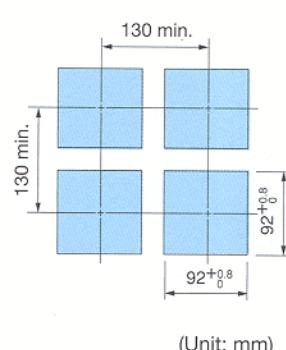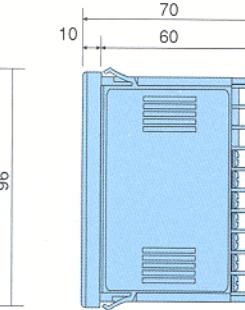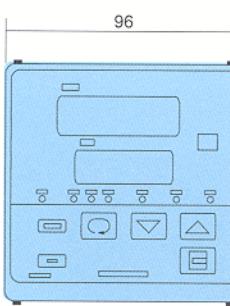


(Unit: mm)

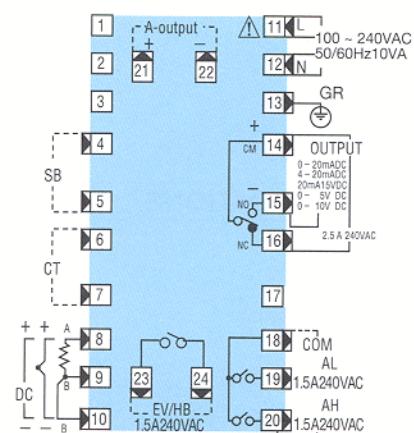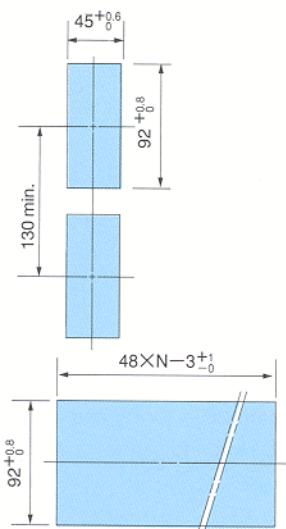**SR64 EXTERNAL DIMENSIONS, PANEL CUTOUT & TERMINAL ARRANGEMENT**


(Unit: mm)

**ACCESSORY (CT) FOR CONTROLLER SPEC WITH HEATER BREAK ALARM (COMMONLY APPLIED TO SR62, SR63 & SR64)**


## ° CT wiring

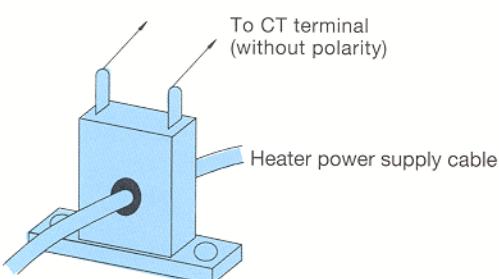

## ° 30A (CTL-6-S)

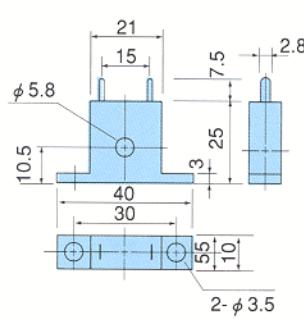

## ° 50A (CTL-12-S36-8)

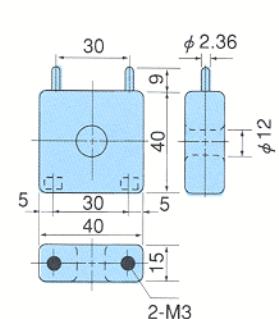

(Unit: mm)